

NOC1


CALMEYER 61

PRØVEHULL 1 327 H

JORDART	Dyp m.	pH
Alm. leire	0,30	8,2
Sandholdig leire	1,0	8,4
Fast leire	2,0	8,6

PRØVEHULL 2 328 H

JORDART	Dyp m.	pH
Fast leire	0,30	8,0
— —	1,0	8,2
— —	2,0	8,4
Alm. leire	3,0	8,6
— —	4,0	8,6
— —	5,0	8,4
— —	6,0	8,6
— —	7,0	8,4
— —	8,0	8,2

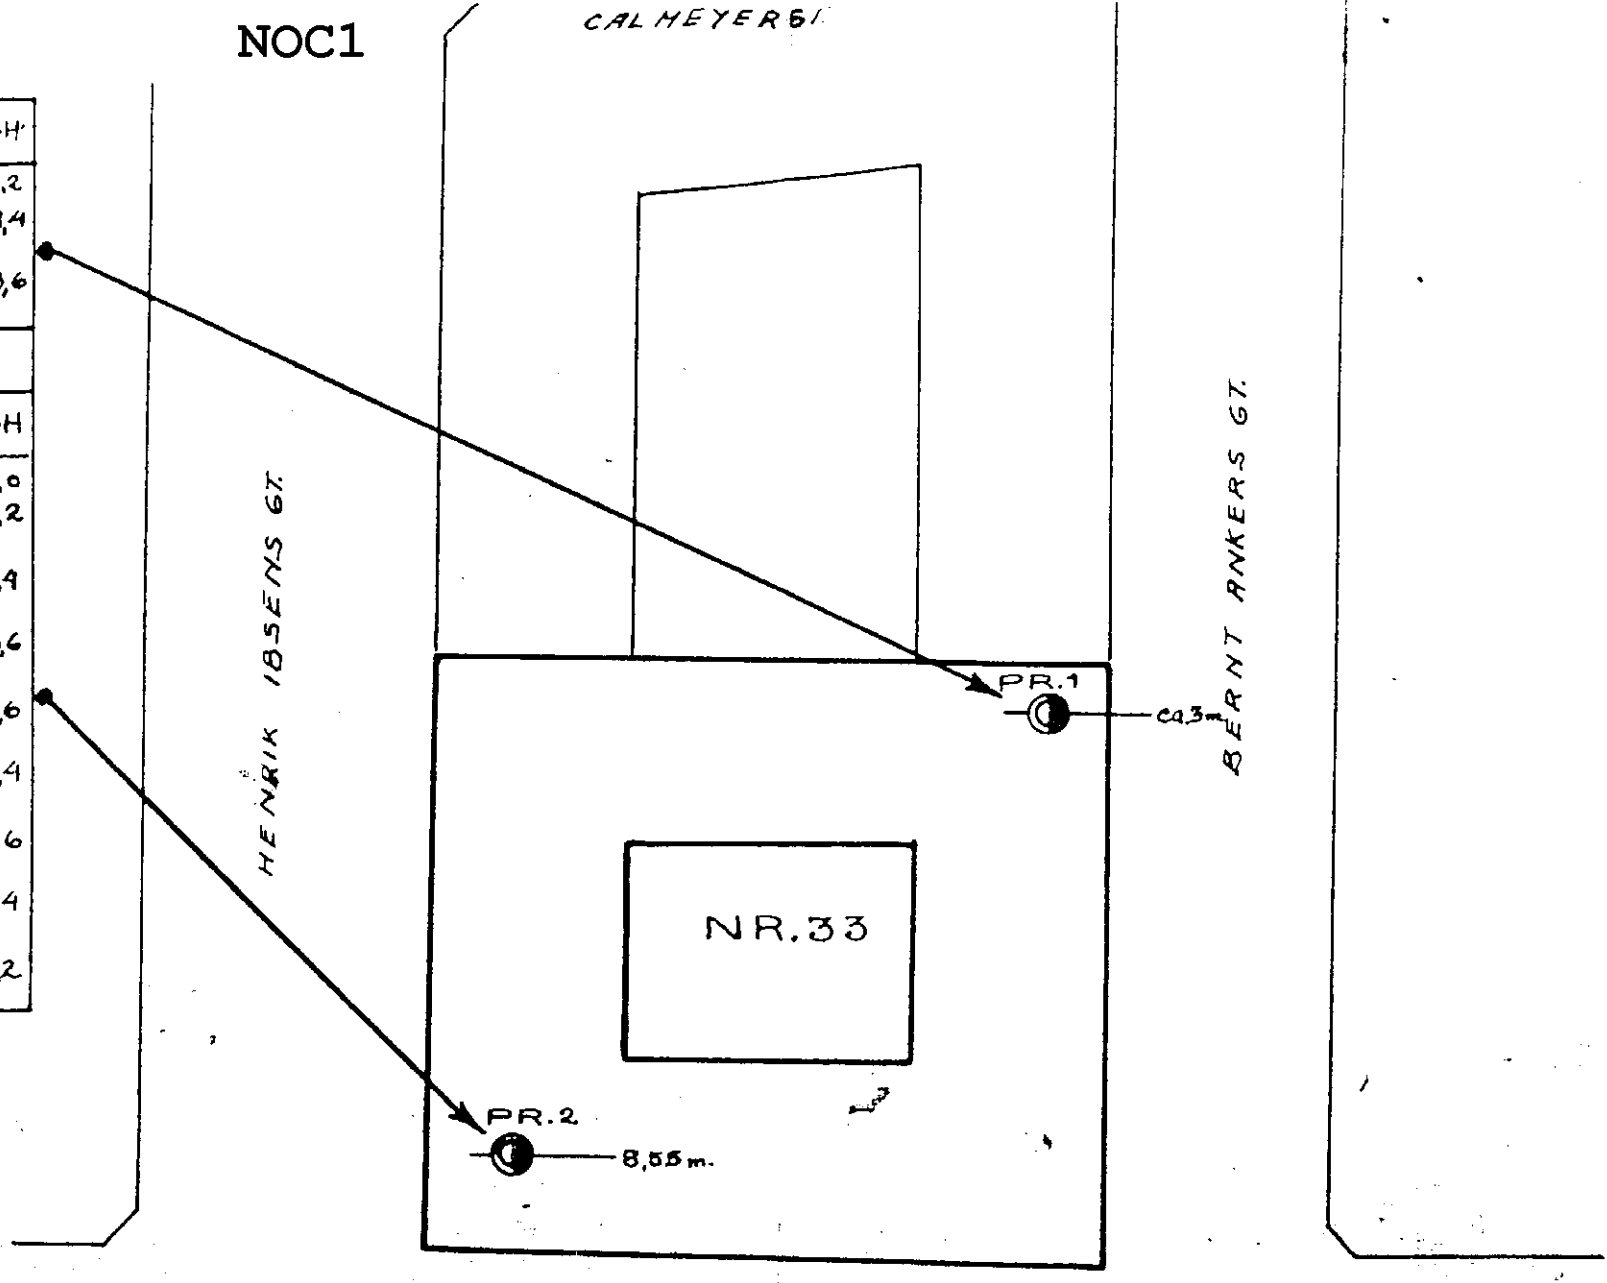

HAUKELID 378
1939

STORGATEN

PLAN 1:500

○ — z — PRØVEHULL

pH = Surhetsgrad (over 7 alk.)

Obs!

z = dybde til fjell fra utgravet tomt.

GRUNNUNDERSØKELSE

AV

STORGT. 33

M. 1:500

MAI-39

M/ 270

Haukelid