

\*NO: B3 IV


1740

Laura Gundersensgt.  
Trafo

TRANSFORMATORKIOSK VED BISLET IDRETTSPASS.  
GRUNNBORINGSKART

Bl. 1740

1:250

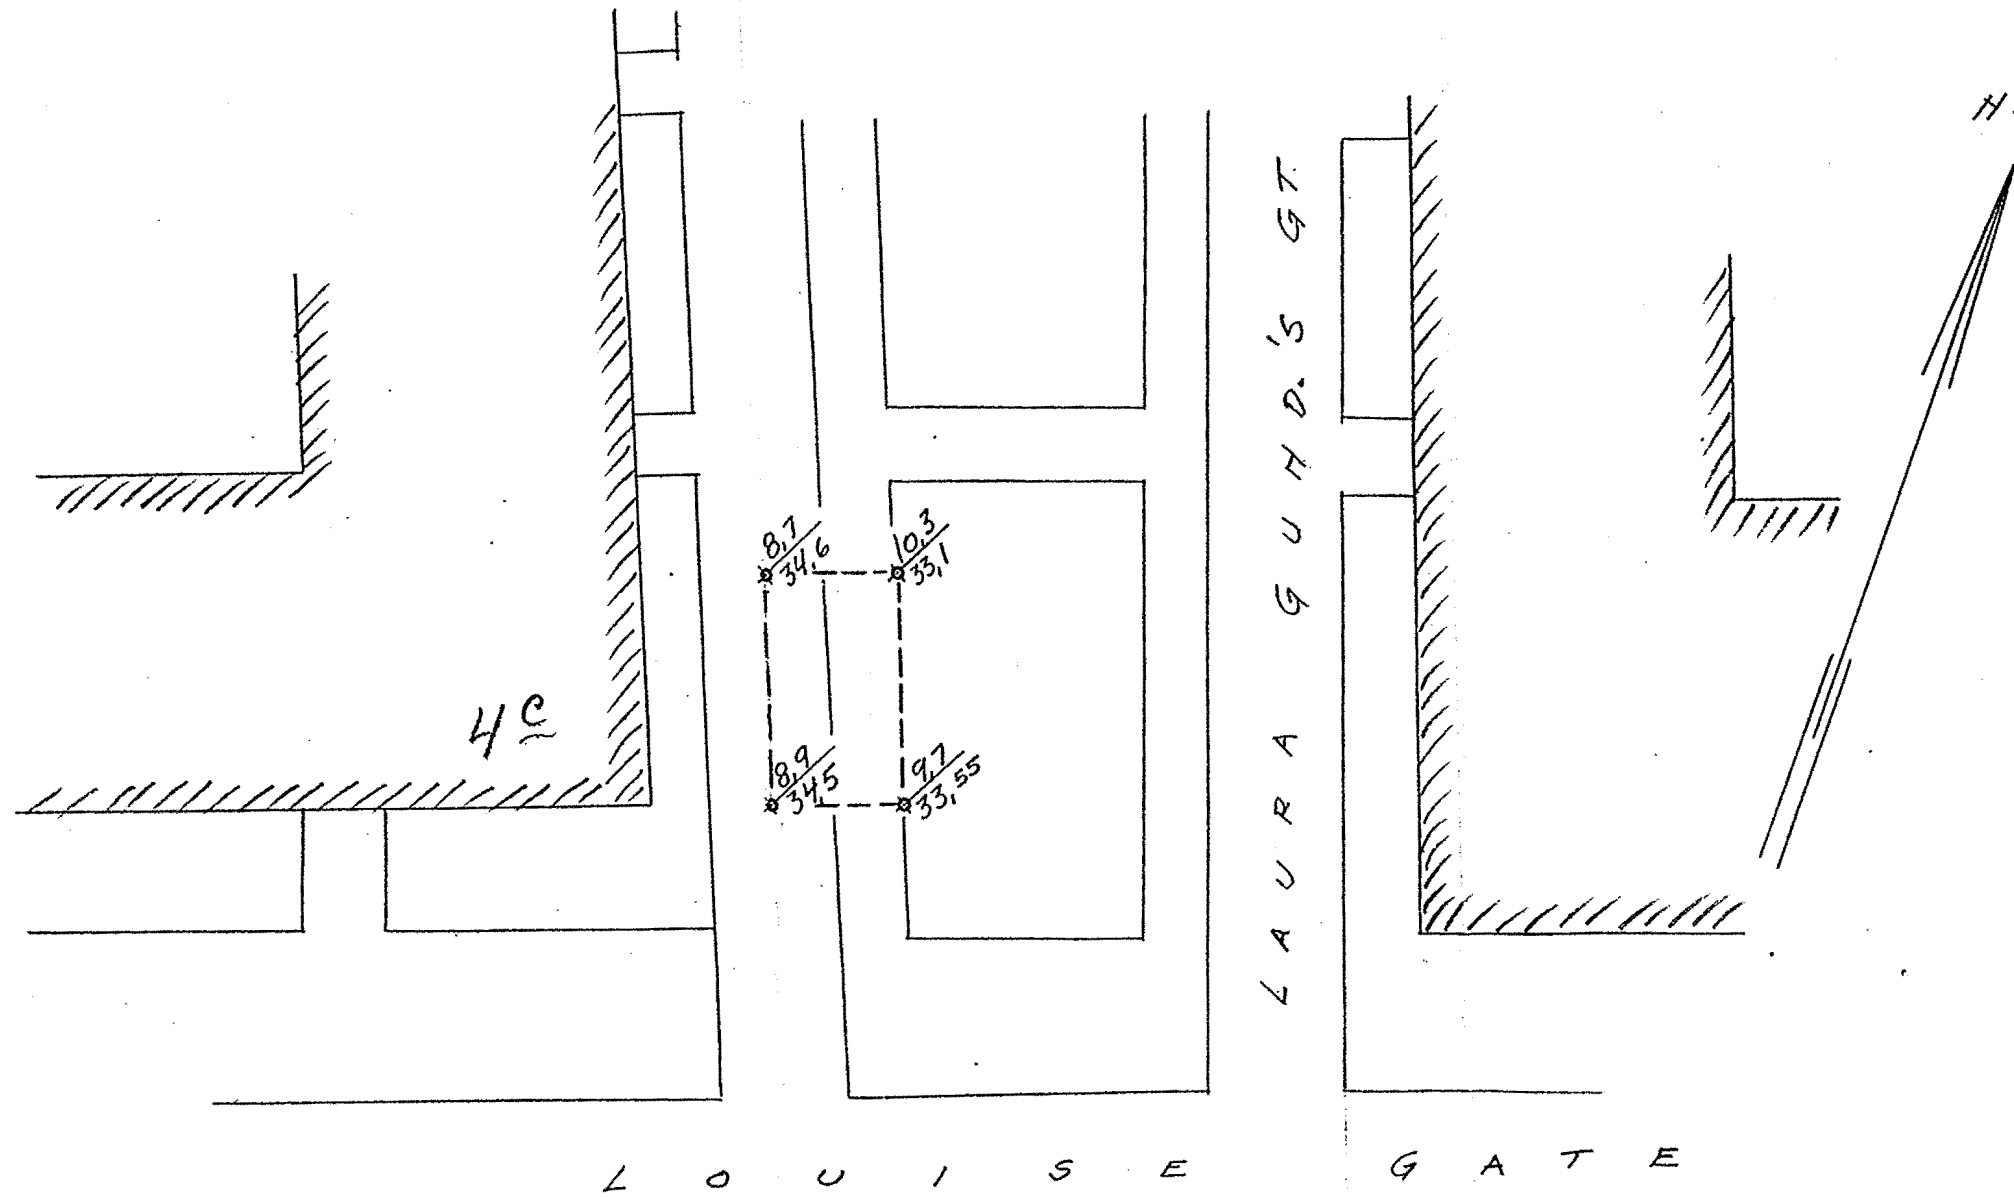

BETEGNELSE

8.7 Boret dybde i m.  
34.6 Antatt fjellkote

Oslo 16/4-36.

*Buism*